




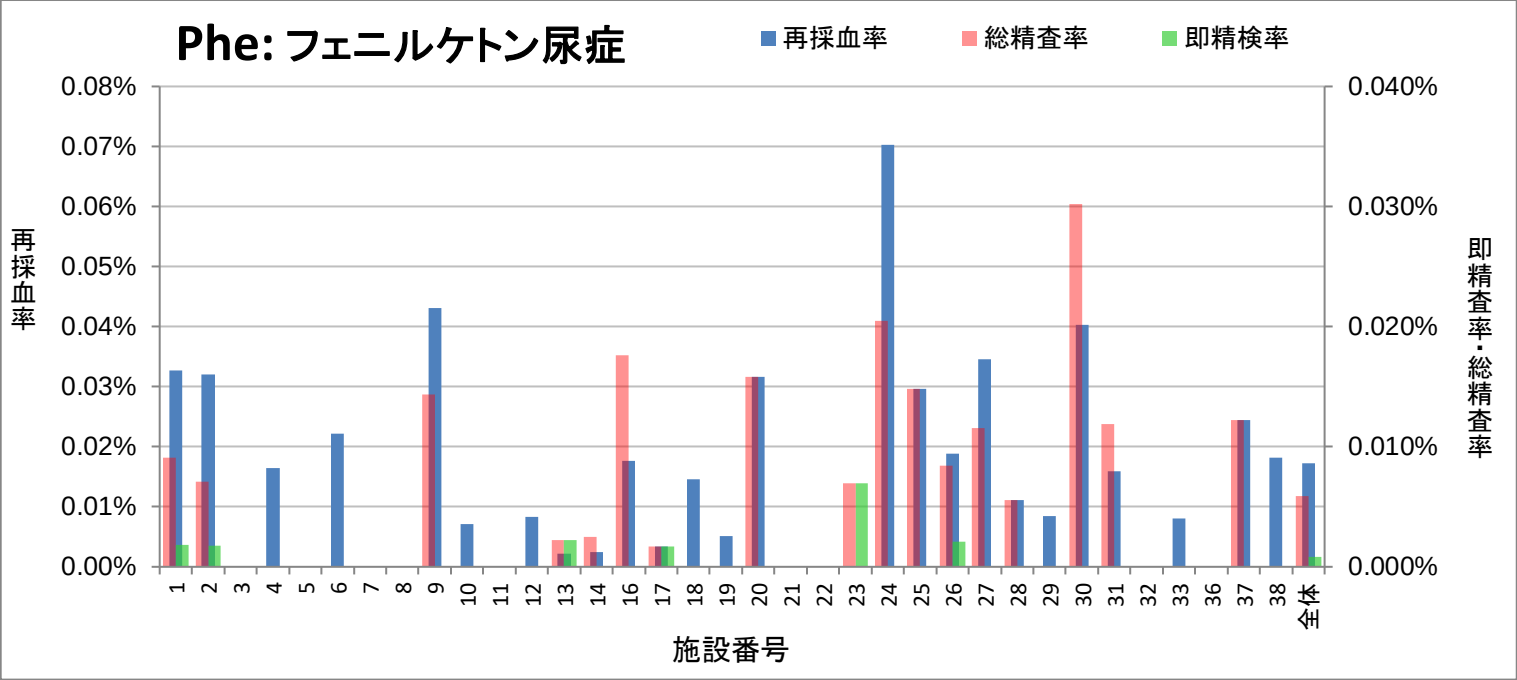


			カットオフ値														
施設 No	検体数	項目	初回 検査	即精査	再採 血数	即精 査数	再採血後 精検数	総精 検数	発見 患者	再採血率	即精検率	再採血後 精検率	総精査率	発見頻度	陽性適中率 (PPV)		
1	55,080	Phe	120	600	18	1	4	5	5	0.033%	0.002%	0.007%	0.009%	1 : 11,016	100.00%		
2	56,207	Phe	120	300	18	1	3	4	1	0.032%	0.002%	0.005%	0.007%	1 : 56,207	25.00%		
3	19,834	Phe	120	600	0	0	0	0	0	—	—	—	—	—	—		
4	6,065	Phe	180	600	1	0	0	0	0	0.016%	—	—	—	—	—		
5	16,223	Phe	180	600	0	0	0	0	—	—	—	—	—	—	—		
6	9,025	Phe	110	—	2	—	—	0	—	0.022%	—	—	—	—	—		
7	12,400	Phe	180	600	0	0	0	0	0	—	—	—	—	—	—		
8	15,090	Phe	180	600	0	0	0	0	0	—	—	—	—	—	—		
9	13,910	Phe	120	300	6	0	2	2	1	0.043%	—	0.014%	0.014%	1 : 13,910	50.00%		
10	14,005	Phe	150	600	1	—	—	0	—	0.007%	—	—	—	—	—		
11	28,752	Phe	180	600	0	0	0	0	0	—	—	—	—	—	—		
12	12,015	Phe	120	480	1	0	0	0	0	0.008%	—	—	—	—	—		
13	89,202	Phe	180	360	2	2	0	2	1	0.002%	0.002%	—	0.002%	1 : 89,202	50.00%		
14	40,179	Phe	130	600	1	0	1	1	1	0.002%	—	0.002%	0.002%	1 : 40,179	100.00%		
16	22,696	Phe	120	500	4	0	4	4	0	0.018%	—	0.018%	0.018%	—	0.00%		
17	59,391	Phe	180	600	2	1	0	1	—	0.003%	0.002%	—	0.002%	—	0.00%		
18	41,033	Phe	150	—	6	0	0	0	0	0.015%	—	—	—	—	—		
19	38,871	Phe	150	600	2	—	—	0	—	0.005%	—	—	—	—	—		
20	12,639	Phe	120	—	4	0	2	2	0	0.032%	—	0.016%	0.016%	—	0.00%		
21	10,746	Phe	120	600	—	—	—	0	—	—	—	—	—	—	—		
22	6,593	Phe	120	600	—	—	—	0	—	—	—	—	—	—	—		
23	14,419	Phe	150	600	0	1	0	1	1	—	0.007%	—	0.007%	1 : 14,419	100.00%		
24	68,307	Phe	100	600	48	0	14	14	—	0.070%	—	0.020%	0.020%	—	0.00%		
25	6,763	Phe	120	500	2	0	1	1	0	0.030%	—	0.015%	0.015%	—	0.00%		
26	47,675	Phe	120	—	9	1	3	4	2	0.019%	0.002%	0.006%	0.008%	1 : 23,838	50.00%		
27	8,672	Phe	120	600	3	—	1	1	1	0.035%	—	0.012%	0.012%	1 : 8,672	100.00%		
28	17,904	Phe	140	242	2	0	1	1	1	0.011%	—	0.006%	0.006%	1 : 17,904	100.00%		
29	23,710	Phe	180	600	2	—	—	0	—	0.008%	—	—	—	—	—		
30	9,938	Phe	120	500	4	0	3	3	0	0.040%	—	0.030%	0.030%	—	0.00%		
31	25,186	Phe	120	—	4	0	3	3	2	0.016%	—	0.012%	0.012%	1 : 12,593	66.67%		
32	4,724	Phe	150	600	0	0	0	0	0	—	—	—	—	—	—		
33	12,330	Phe	120	400	1	—	—	0	—	0.008%	—	—	—	—	—		
36	12,795	Phe	180	600	0	0	0	0	—	—	—	—	—	—	—		
37	8,190	Phe	120	—	2	0	1	1	0	0.024%	—	0.012%	0.012%	—	0.00%		
38	5,509	Phe	130	—	1	0	0	0	0	0.018%	—	—	—	—	—		
全体	846,078	Phe	140.00	535.07	146	7	43	50	16	0.017%	0.001%	0.005%	0.006%	1 : 52,880	32.00%		
										max	0.070%	0.007%	0.030%	0.030%	100.00%		
										min	0.002%	0.002%	0.002%	0.002%	0.00%		

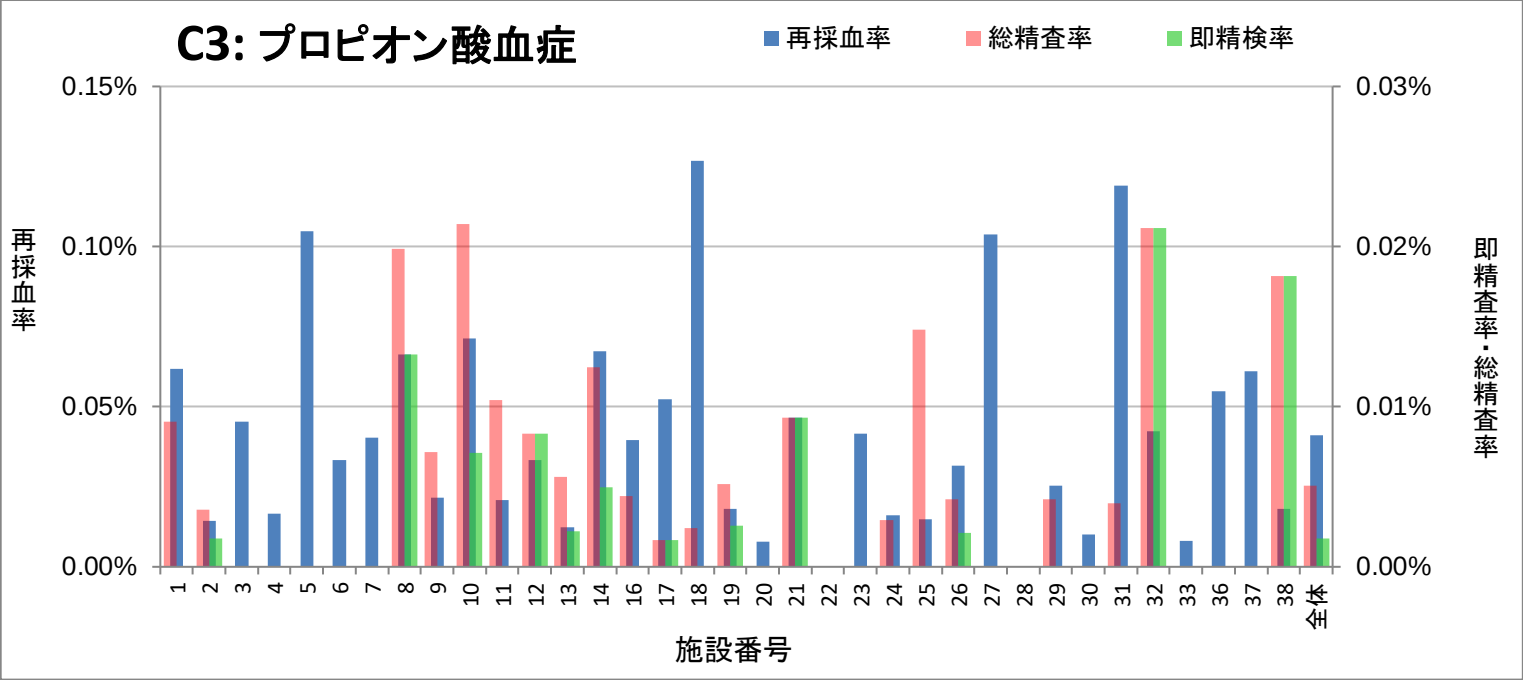


施設No	検体数	項目	カットオフ値		再採血数	即精査数	再採血後精検数	総精検数	発見患者	再採血率	即精検率	再採血後精検率	総精査率	発見頻度	陽性適中率 (PPV)
			初回検査	即精査											
1	55,080	C3	4	8	34	0	5	5	4	0.062%	—	0.009%	0.009%	1 : 13,770	80.00%
2	56,207	C3	4	8	8	1	1	2	2	0.014%	0.002%	0.002%	0.004%	1 : 28,104	100.00%
3	19,834	C3	3.6	8	9	0	0	0	0	0.045%	—	—	—	—	—
4	6,065	C3	3.5	7.6	1	0	0	0	0	0.016%	—	—	—	—	—
5	16,223	C3	3.6	8	17	0	0	0	—	0.105%	—	—	—	—	—
6	9,025	C3	3.4	8	3	—	—	0	—	0.033%	—	—	—	—	—
7	12,400	C3	3.6	8	5	0	0	0	0	0.040%	—	—	—	—	—
8	15,090	C3	3.6	8	10	2	1	3	1	0.066%	0.013%	0.007%	0.020%	1 : 15,090	33.33%
9	13,910	C3	4	—	3	0	1	1	1	0.022%	—	0.007%	0.007%	1 : 13,910	100.00%
10	14,005	C3	3.6	8	10	1	2	3	1	0.071%	0.007%	0.014%	0.021%	1 : 14,005	33.33%
11	28,752	C3	3.6	8	6	0	3	3	3	0.021%	—	0.010%	0.010%	1 : 9,584	100.00%
12	12,015	C3	3.6	8	4	1	0	1	1	0.033%	0.008%	—	0.008%	1 : 12,015	100.00%
13	89,202	C3	3.6	5	11	2	3	5	2	0.012%	0.002%	0.003%	0.006%	1 : 44,601	40.00%
14	40,179	C3	4	8	27	2	3	5	2	0.067%	0.005%	0.007%	0.012%	1 : 20,090	40.00%
16	22,696	C3	4	8	9	0	1	1	0	0.040%	—	0.004%	0.004%	—	0.00%
17	59,391	C3	3.5	8	31	1	0	1	—	0.052%	0.002%	—	0.002%	—	0.00%
18	41,033	C3	3.5	—	52	0	1	1	0	0.127%	—	0.002%	0.002%	—	0.00%
19	38,871	C3	3.6	8	7	1	1	2	1	0.018%	0.003%	0.003%	0.005%	1 : 38,871	50.00%
20	12,639	C3	3.5	—	1	0	0	0	0	0.008%	—	—	—	—	—
21	10,746	C3	3.8	8	5	1	—	1	—	0.047%	0.009%	—	0.009%	—	0.00%
22	6,593	C3	3.5	8	—	—	—	0	—	—	—	—	—	—	—
23	14,419	C3	4.2	8	6	0	0	0	0	0.042%	—	—	—	—	—
24	68,307	C3	3.6	8	11	0	2	2	—	0.016%	—	0.003%	0.003%	—	0.00%
25	6,763	C3	3.9	8	1	0	1	1	1	0.015%	—	0.015%	0.015%	1 : 6,763	100.00%
26	47,675	C3	3.6	8	15	1	1	2	1	0.031%	0.002%	0.002%	0.004%	1 : 47,675	50.00%
27	8,672	C3	4.7	8	9	—	—	0	—	0.104%	—	—	—	—	—
28	17,904	C3	3.6	8	0	0	0	0	0	—	—	—	—	—	—
29	23,710	C3	3.6	8	6	—	1	1	1	0.025%	—	0.004%	0.004%	1 : 23,710	100.00%
30	9,938	C3	3.5	8	1	0	0	0	0	0.010%	—	—	—	—	—
31	25,186	C3	3.6	8	30	0	1	1	0	0.119%	—	0.004%	0.004%	—	0.00%
32	4,724	C3	3.5	8	2	1	0	1	0	0.042%	0.021%	—	0.021%	—	0.00%
33	12,330	C3	4	10	1	—	—	0	—	0.008%	—	—	—	—	—
36	12,795	C3	3.6	8	7	0	0	0	—	0.055%	—	—	—	—	—
37	8,190	C3	3.8	—	5	0	0	0	0	0.061%	—	—	—	—	—
38	5,509	C3	3.6	7.5	1	1	0	1	0	0.018%	0.018%	—	0.018%	—	0.00%
全体	846,078	C3	3.71	7.94	348	15	28	43	21	0.041%	0.002%	0.003%	0.005%	1 : 40,289	48.84%
										max	0.127%	0.021%	0.015%	0.021%	100.00%
										min	0.008%	0.002%	0.002%	0.002%	0.00%

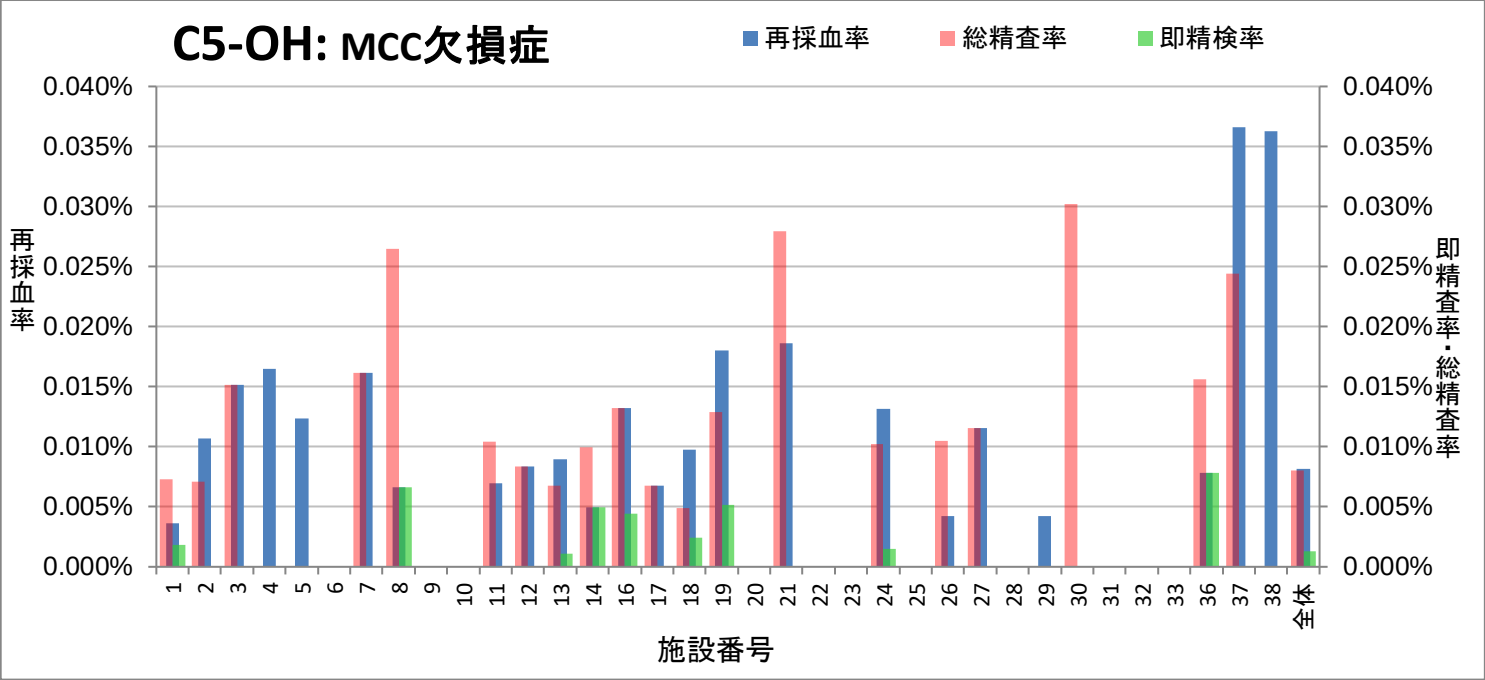


			カットオフ値													
施設 No	検体数	項目	初回 検査	即精査	再採 血数	即精 査数	再採血後 精検数	総精 検数	発見 患者	再採血率	即精検率	再採血後 精検率	総精査率	発見頻度	陽性適中率 (PPV)	
1	55,080	C5-OH	1	2	2	1	3	4	1	0.004%	0.002%	0.005%	0.007%	1 : 55,080	25.00%	
2	56,207	C5-OH	1	2	6	0	4	4	0	0.011%	-	0.007%	0.007%	-	0.00%	
3	19,834	C5-OH	1	2	3	0	3	3	0	0.015%	-	0.015%	0.015%	-	0.00%	
4	6,065	C5-OH	1	2	1	0	0	0	0	0.016%	-	-	-	-	-	
5	16,223	C5-OH	1		2	0	0	0		0.012%	-	-	-	-	-	
6	9,025	C5-OH	1	2				0		-	-	-	-	-	-	
7	12,400	C5-OH	1	2	2	0	2	2	0	0.016%	-	0.016%	0.016%	-	0.00%	
8	15,090	C5-OH	1	2	1	1	3	4	1	0.007%	0.007%	0.020%	0.027%	1 : 15,090	25.00%	
9	13,910	C5-OH	1		0	0	0	0	0	-	-	-	-	-	-	
10	14,005	C5-OH	1	2				0		-	-	-	-	-	-	
11	28,752	C5-OH	1	2	2	0	3	3	0	0.007%	-	0.010%	0.010%	-	0.00%	
12	12,015	C5-OH	1	2	1	0	1	1	0	0.008%	-	0.008%	0.008%	-	0.00%	
13	89,202	C5-OH	1	2	8	1	5	6	1	0.009%	0.001%	0.006%	0.007%	1 : 89,202	16.67%	
14	40,179	C5-OH	1	2	2	2	2	4	2	0.005%	0.005%	0.005%	0.010%	1 : 20,090	50.00%	
16	22,696	C5-OH	1	2	3	1	2	3	0	0.013%	0.004%	0.009%	0.013%	-	0.00%	
17	59,391	C5-OH	1	2	4	0	4	4		0.007%	-	0.007%	0.007%	-	0.00%	
18	41,033	C5-OH	1		4	1	1	2	1	0.010%	0.002%	0.002%	0.005%	1 : 41,033	50.00%	
19	38,871	C5-OH	1	2	7	2	3	5	1	0.018%	0.005%	0.008%	0.013%	1 : 38,871	20.00%	
20	12,639	C5-OH	1		0	0	0	0	0	-	-	-	-	-	-	
21	10,746	C5-OH	0.8	2	2		3	3		0.019%	-	0.028%	0.028%	-	0.00%	
22	6,593	C5-OH	1	2				0		-	-	-	-	-	-	
23	14,419	C5-OH	1	2	0	0	0	0	0	-	-	-	-	-	-	
24	68,307	C5-OH	1	2	9	1	6	7		0.013%	0.001%	0.009%	0.010%	-	0.00%	
25	6,763	C5-OH	1	2	0	0	0	0	0	-	-	-	-	-	-	
26	47,675	C5-OH	1	2	2		5	5		0.004%	-	0.010%	0.010%	-	0.00%	
27	8,672	C5-OH	0.9	2	1		1	1		0.012%	-	0.012%	0.012%	-	0.00%	
28	17,904	C5-OH	1	2	0	0	0	0	0	-	-	-	-	-	-	
29	23,710	C5-OH	1	2	1			0		0.004%	-	-	-	-	-	
30	9,938	C5-OH	1	2	0	0	3	3	0	-	-	0.030%	0.030%	-	0.00%	
31	25,186	C5-OH	1	2	0	0	0	0	0	-	-	-	-	-	-	
32	4,724	C5-OH	1	2	0	0	0	0	0	-	-	-	-	-	-	
33	12,330	C5-OH	0.9	2				0		-	-	-	-	-	-	
36	12,795	C5-OH	1	2	1	1	1	2		0.008%	0.008%	0.008%	0.016%	-	0.00%	
37	8,190	C5-OH	1		3	0	2	2	0	0.037%	-	0.024%	0.024%	-	0.00%	
38	5,509	C5-OH	1	1.5	2	0	0	0	0	0.036%	-	-	-	-	-	
全体	846,078	C5-OH	0.99	1.98	69	11	57	68	7	0.008%	0.001%	0.007%	0.008%	1 : 120,868	10.29%	
										max	0.037%	0.008%	0.030%	0.030%		50.00%
										min	0.004%	0.001%	0.002%	0.005%		0.00%

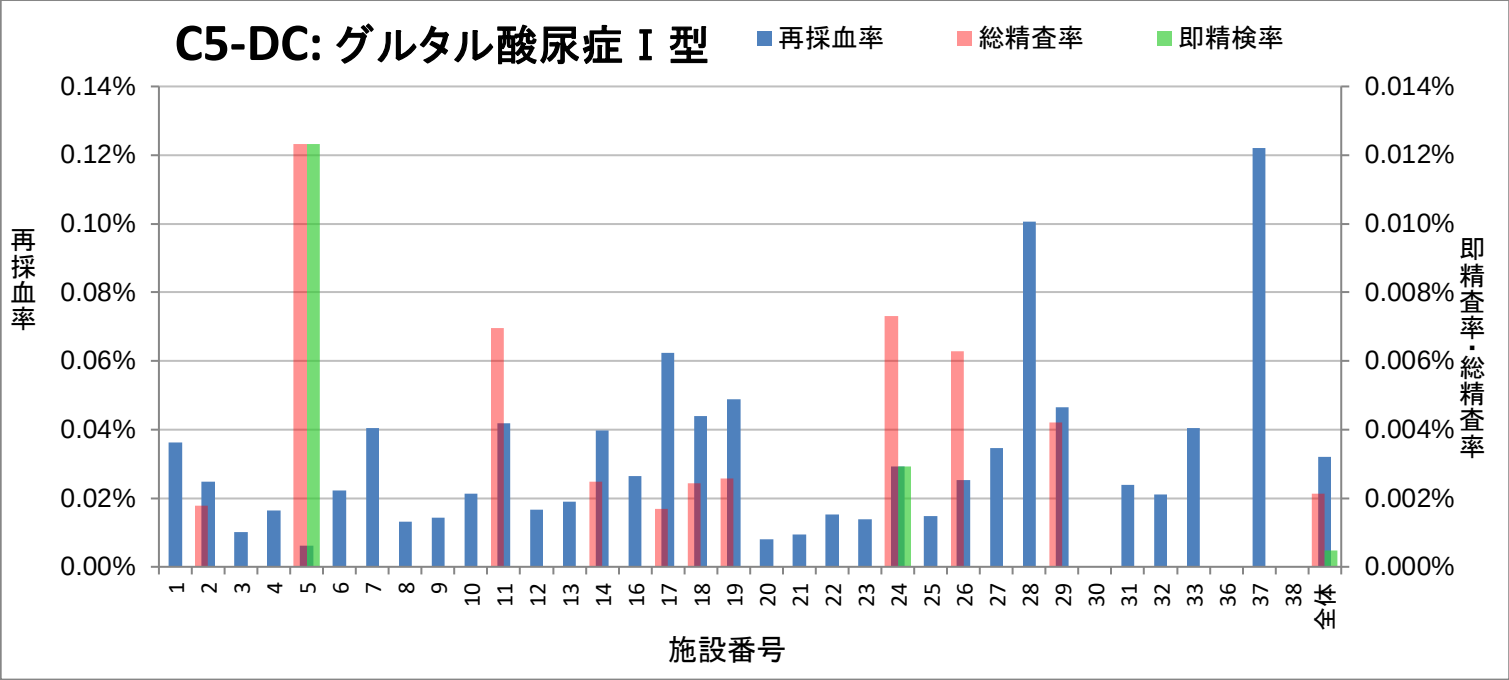


		カットオフ値													
施設 No	検体数	項目	初回検査	即精査	再採血数	即精査数	再採血後精検数	総精検数	発見患者	再採血率	即精検率	再採血後精検率	総精査率	発見頻度	陽性適中率 (PPV)
1	55,080	C5-DC	0.3		20	0	0	0	0	0.036%	-	-	-	-	-
2	56,207	C5-DC	0.3		14	0	1	1	0	0.025%	-	0.002%	0.002%	-	0.00%
3	19,834	C5-DC	0.35		2	0	0	0	0	0.010%	-	-	-	-	-
4	6,065	C5-DC	0.31		1	0	0	0	0	0.016%	-	-	-	-	-
5	16,223	C5-DC	0.35		1	2	0	2	1	0.006%	0.012%	-	0.012%	1 : 16,223	50.00%
6	9,025	C5-DC	0.21		2			0		0.022%	-	-	-	-	-
7	12,400	C5-DC	0.25		5	0	0	0	0	0.040%	-	-	-	-	-
8	15,090	C5-DC	0.3		2	0	0	0	0	0.013%	-	-	-	-	-
9	13,910	C5-DC	0.35	0.7	2	0	0	0	0	0.014%	-	-	-	-	-
10	14,005	C5-DC	0.25		3			0		0.021%	-	-	-	-	-
11	28,752	C5-DC	0.25		12	0	2	2	0	0.042%	-	0.007%	0.007%	-	0.00%
12	12,015	C5-DC	0.25		2	0	0	0	0	0.017%	-	-	-	-	-
13	89,202	C5-DC	0.25	0.7	17	0	0	0	0	0.019%	-	-	-	-	-
14	40,179	C5-DC	0.35		16	0	1	1	0	0.040%	-	0.002%	0.002%	-	0.00%
16	22,696	C5-DC	0.27	0.8	6	0	0	0	0	0.026%	-	-	-	-	-
17	59,391	C5-DC	0.25		37	0	1	1		0.062%	-	0.002%	0.002%	-	0.00%
18	41,033	C5-DC	0.3		18	0	1	1	0	0.044%	-	0.002%	0.002%	-	0.00%
19	38,871	C5-DC	0.25		19		1	1		0.049%	-	0.003%	0.003%	-	0.00%
20	12,639	C5-DC	0.3		1	0	0	0	0	0.008%	-	-	-	-	-
21	10,746	C5-DC	0.3		1			0		0.009%	-	-	-	-	-
22	6,593	C5-DC	0.29		1			0		0.015%	-	-	-	-	-
23	14,419	C5-DC	0.25		2	0	0	0	0	0.014%	-	-	-	-	-
24	68,307	C5-DC	0.25		20	2	3	5		0.029%	0.003%	0.004%	0.007%	-	0.00%
25	6,763	C5-DC	0.35		1	0	0	0	0	0.015%	-	-	-	-	-
26	47,675	C5-DC	0.29		12		3	3		0.025%	-	0.006%	0.006%	-	0.00%
27	8,672	C5-DC	0.25		3			0		0.035%	-	-	-	-	-
28	17,904	C5-DC	0.2		18	0	0	0	0	0.101%	-	-	-	-	-
29	23,710	C5-DC	0.25		11		1	1		0.046%	-	0.004%	0.004%	-	0.00%
30	9,938	C5-DC	0.3		0	0	0	0	0	-	-	-	-	-	-
31	25,186	C5-DC	0.25		6	0	0	0	0	0.024%	-	-	-	-	-
32	4,724	C5-DC	0.25		1	0	0	0	0	0.021%	-	-	-	-	-
33	12,330	C5-DC	0.25		5			0		0.041%	-	-	-	-	-
36	12,795	C5-DC	0.25	-	0	0	0	0		-	-	-	-	-	-
37	8,190	C5-DC	0.22		10	0	0	0	0	0.122%	-	-	-	-	-
38	5,509	C5-DC	0.35		0	0	0	0	0	-	-	-	-	-	-
全体	846,078	C5-DC	0.28	0.73	271	4	14	18	1	0.032%	0.000%	0.002%	0.002%	1 : 846,078	5.56%
max										0.122%	0.012%	0.007%	0.012%		50.00%
min										0.006%	0.003%	0.002%	0.002%		0.00%

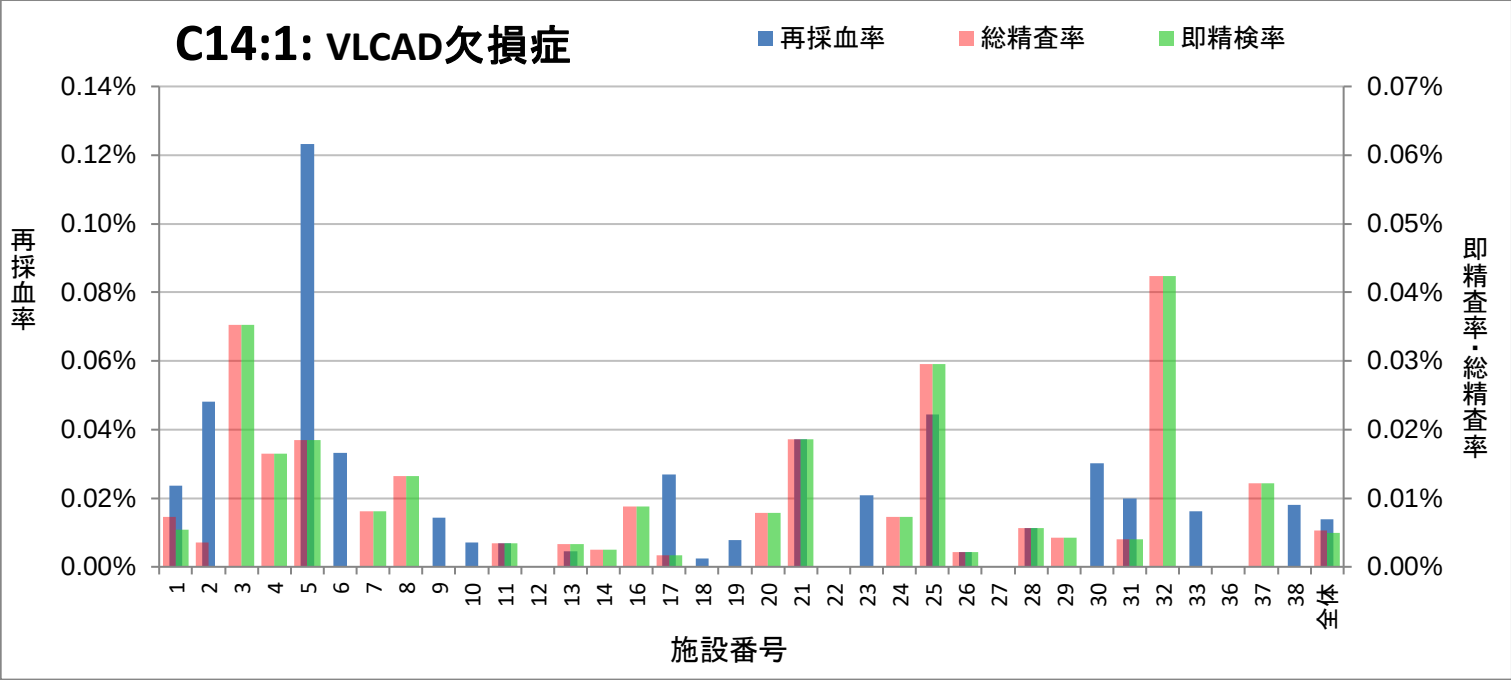

			カットオフ値													
施設 No	検体数	項目	初回 検査	即精査	再採 血数	即精 査数	再採血後 精検数	総精 検数	発見 患者	再採血率	即精検率	再採血後 精検率	総精査率	発見頻度	陽性適中率 (PPV)	
1	55,080	C14:1	0.35	1	13	3	1	4	1	0.024%	0.005%	0.002%	0.007%	1 : 55,080	25.00%	
2	56,207	C14:1	0.27	1	27	0	2	2	2	0.048%	—	0.004%	0.004%	1 : 28,104	100.00%	
3	19,834	C14:1	0.3	0.3	0	7	0	7	0	—	0.035%	—	0.035%	—	0.00%	
4	6,065	C14:1	0.25	0.25	0	1	0	1	0	—	0.016%	—	0.016%	—	0.00%	
5	16,223	C14:1	0.4	—	20	3	0	3	—	0.123%	0.018%	—	0.018%	—	0.00%	
6	9,025	C14:1	—	0.22	3	—	—	0	—	0.033%	—	—	—	—	—	
7	12,400	C14:1	—	0.3	0	1	0	1	0	—	0.008%	—	0.008%	—	0.00%	
8	15,090	C14:1	0.4	1	0	2	0	2	1	—	0.013%	—	0.013%	1 : 15,090	50.00%	
9	13,910	C14:1	0.4	1	2	0	0	0	0	0.014%	—	—	—	—	—	
10	14,005	C14:1	0.3	1	1	—	—	0	—	0.007%	—	—	—	—	—	
11	28,752	C14:1	0.4	1	2	1	0	1	1	0.007%	0.003%	—	0.003%	1 : 28,752	100.00%	
12	12,015	C14:1	—	0.4	0	0	0	0	0	—	—	—	—	—	—	
13	89,202	C14:1	0.4	0.4	4	3	0	3	—	0.004%	0.003%	—	0.003%	—	0.00%	
14	40,179	C14:1	0.4	0.4	0	1	0	1	1	—	0.002%	—	0.002%	1 : 40,179	100.00%	
16	22,696	C14:1	0.4	0.4	0	2	0	2	0	—	0.009%	—	0.009%	—	0.00%	
17	59,391	C14:1	0.4	1	16	1	0	1	—	0.027%	0.002%	—	0.002%	—	0.00%	
18	41,033	C14:1	—	0.4	1	0	0	0	0	0.002%	—	—	—	—	—	
19	38,871	C14:1	0.4	1	3	—	—	0	—	0.008%	—	—	—	—	—	
20	12,639	C14:1	0.4	—	0	1	0	1	1	—	0.008%	—	0.008%	1 : 12,639	100.00%	
21	10,746	C14:1	0.27	1	4	2	—	2	—	0.037%	0.019%	—	0.019%	—	0.00%	
22	6,593	C14:1	0.27	1	—	—	—	0	—	—	—	—	—	—	—	
23	14,419	C14:1	0.3	1	3	0	0	0	0	0.021%	—	—	—	—	—	
24	68,307	C14:1	—	0.4	0	5	0	5	—	—	0.007%	—	0.007%	—	0.00%	
25	6,763	C14:1	0.3	0.3	3	2	0	2	1	0.044%	0.030%	—	0.030%	1 : 6,763	50.00%	
26	47,675	C14:1	0.4	0.4	2	1	—	1	—	0.004%	0.002%	—	0.002%	—	0.00%	
27	8,672	C14:1	0.27	—	—	—	—	0	—	—	—	—	—	—	—	
28	17,904	C14:1	0.35	—	2	1	0	1	0	0.011%	0.006%	—	0.006%	—	0.00%	
29	23,710	C14:1	0.4	0.4	—	1	—	1	—	—	0.004%	—	0.004%	—	0.00%	
30	9,938	C14:1	0.3	1	3	0	0	0	0	0.030%	—	—	—	—	—	
31	25,186	C14:1	0.3	0.3	5	1	0	1	1	0.020%	0.004%	—	0.004%	1 : 25,186	100.00%	
32	4,724	C14:1	0.26	0.26	0	2	0	2	0	—	0.042%	—	0.042%	—	0.00%	
33	12,330	C14:1	0.3	0.8	2	—	—	0	—	0.016%	—	—	—	—	—	
36	12,795	C14:1	0.4	—	0	0	0	0	—	—	—	—	—	—	—	
37	8,190	C14:1	0.25	0.25	0	1	0	1	0	—	0.012%	—	0.012%	—	0.00%	
38	5,509	C14:1	0.35	1	1	0	0	0	0	0.018%	—	—	—	—	—	
全体	846,078	C14:1	0.34	0.64	117	42	3	45	9	0.014%	0.005%	0.000%	0.005%	1 : 94,009	20.00%	
										max	0.123%	0.042%	0.004%	0.042%		100.00%
										min	0.002%	0.002%	0.002%	0.002%		0.00%

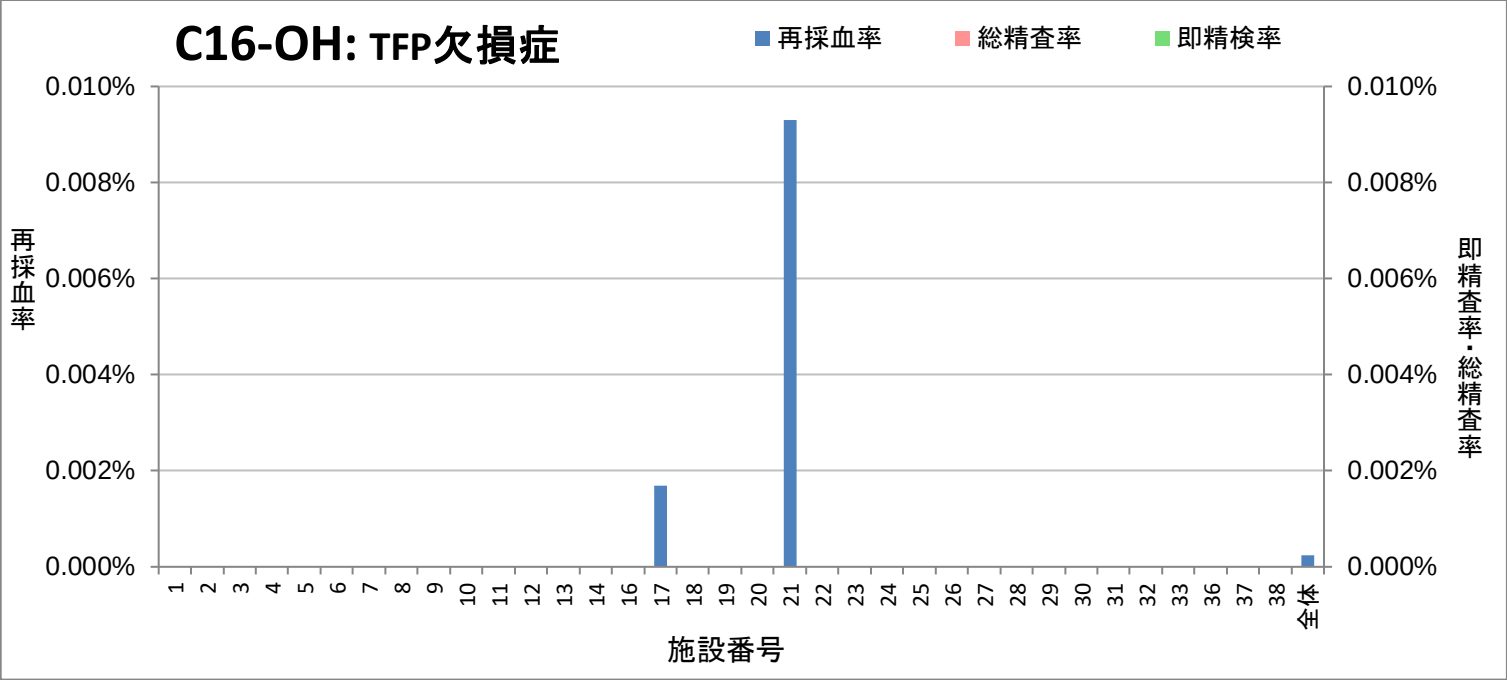

		カットオフ値													
施設No	検体数	項目	初回検査	即精査	再採血数	即精査数	再採血後精検数	総精検数	発見患者	再採血率	即精検率	再採血後精検率	総精査率	発見頻度	陽性適中率 (PPV)
1	55,080	C16-OH	0.05		0	0	0	0	0	-	-	-	-	-	
2	56,207	C16-OH	0.05		0	0	0	0	0	-	-	-	-	-	
3	19,834	C16-OH	0.05	0.05	0	0	0	0	0	-	-	-	-	-	
4	6,065	C16-OH	0.08	0.08	0	0	0	0	0	-	-	-	-	-	
5	16,223	C16-OH	0.1		0	0	0	0		-	-	-	-	-	
6	9,025	C16-OH		0.05				0		-	-	-	-	-	
7	12,400	C16-OH	0.1		0	0	0	0	0	-	-	-	-	-	
8	15,090	C16-OH	0.05	0.5	0	0	0	0	0	-	-	-	-	-	
9	13,910	C16-OH	0.1		0	0	0	0	0	-	-	-	-	-	
10	14,005	C16-OH	0.08					0		-	-	-	-	-	
11	28,752	C16-OH		0.1	0	0	0	0	0	-	-	-	-	-	
12	12,015	C16-OH		0.1	0	0	0	0	0	-	-	-	-	-	
13	89,202	C16-OH	0.05		0	0	0	0		-	-	-	-	-	
14	40,179	C16-OH	0.1	0.1	0	0	0	0	0	-	-	-	-	-	
16	22,696	C16-OH	0.05	0.5	0	0	0	0	0	-	-	-	-	-	
17	59,391	C16-OH	0.05		1	0	0	0		0.002%	-	-	-	-	
18	41,033	C16-OH		0.04	0	0	0	0	0	-	-	-	-	-	
19	38,871	C16-OH	0.05					0		-	-	-	-	-	
20	12,639	C16-OH	0.05		0	0	0	0	0	-	-	-	-	-	
21	10,746	C16-OH	0.05		1			0		0.009%	-	-	-	-	
22	6,593	C16-OH	0.05					0		-	-	-	-	-	
23	14,419	C16-OH	0.08		0	0	0	0	0	-	-	-	-	-	
24	68,307	C16-OH		0.04	0	0	0	0		-	-	-	-	-	
25	6,763	C16-OH	0.1	0.1	0	0	0	0	0	-	-	-	-	-	
26	47,675	C16-OH	0.05	0.05				0		-	-	-	-	-	
27	8,672	C16-OH	0.045					0		-	-	-	-	-	
28	17,904	C16-OH	0.1		0	0	0	0	0	-	-	-	-	-	
29	23,710	C16-OH	0.1	0.1				0		-	-	-	-	-	
30	9,938	C16-OH	0.05		0	0	0	0	0	-	-	-	-	-	
31	25,186	C16-OH	0.07	0.07	0	0	0	0	0	-	-	-	-	-	
32	4,724	C16-OH	0.08	0.08	0	0	0	0	0	-	-	-	-	-	
33	12,330	C16-OH	0.05					0		-	-	-	-	-	
36	12,795	C16-OH	0.1	-	0	0	0	0		-	-	-	-	-	
37	8,190	C16-OH	0.08		0	0	0	0	0	-	-	-	-	-	
38	5,509	C16-OH	0.08		0	0	0	0	0	-	-	-	-	-	
全体	846,078	C16-OH	0.07	0.13	2	0	0	0	0	0.000%	-	-	-	-	
max										0.009%	0.000%	0.000%	0.000%		0.00%
min										0.002%	0.000%	0.000%	0.000%		0.00%

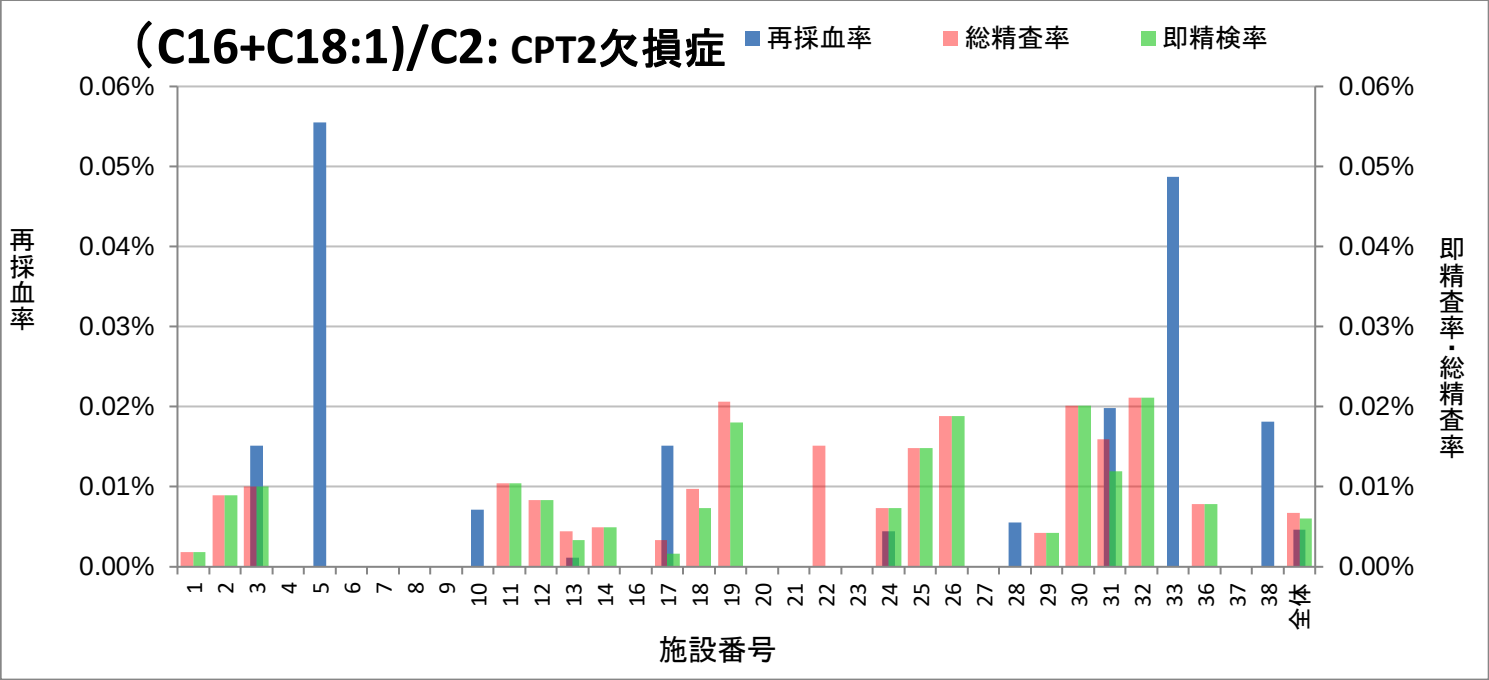

施設No	検体数	項目	カットオフ値		再採血数	即精査数	再採血後精検数	総精検数	発見患者	再採血率	即精検率	再採血後精検率	総精査率	発見頻度	陽性適中率 (PPV)
			初回検査	即精査											
1	55,080	(C16+C18:1)/C2		0.34	0	1	0	1	0	—	0.002%	—	0.002%	—	0.00%
2	56,207	(C16+C18:1)/C2	0.65	0.65	0	5	0	5	0	—	0.009%	—	0.009%	—	0.00%
3	19,834	(C16+C18:1)/C2	0.38	0.38	3	2	0	2	0	0.015%	0.010%	—	0.010%	—	0.00%
4	6,065	(C16+C18:1)/C2	0.37	0.37	0	0	0	0	0	—	—	—	—	—	—
5	16,223	(C16+C18:1)/C2	0.45		9	0	0	0		0.055%	—	—	—	—	—
6	9,025	(C16+C18:1)/C2		0.39				0		—	—	—	—	—	—
7	12,400	(C16+C18:1)/C2		0.4	0	0	0	0	0	—	—	—	—	—	—
8	15,090	(C16+C18:1)/C2	0.4		0	0	0	0	0	—	—	—	—	—	—
9	13,910	(C16+C18:1)/C2	0.38		0	0	0	0	0	—	—	—	—	—	—
10	14,005	(C16+C18:1)/C2	0.42		1			0		0.007%	—	—	—	—	—
11	28,752	(C16+C18:1)/C2		0.4	0	3	0	3	0	—	0.010%	—	0.010%	—	0.00%
12	12,015	(C16+C18:1)/C2		0.35	0	1	0	1	0	—	0.008%	—	0.008%	—	0.00%
13	89,202	(C16+C18:1)/C2	0.4		1	3	1	4	1	0.001%	0.003%	0.001%	0.004%	1 : 89,202	25.00%
14	40,179	(C16+C18:1)/C2	0.37	0.37	0	2	0	2	0	—	0.005%	—	0.005%	—	0.00%
16	22,696	(C16+C18:1)/C2		0.4	0	0	0	0	0	—	—	—	—	—	—
17	59,391	(C16+C18:1)/C2	0.36		9	1	1	2		0.015%	0.002%	0.002%	0.003%	—	0.00%
18	41,033	(C16+C18:1)/C2		0.4	0	3	1	4	0	—	0.007%	0.002%	0.010%	—	0.00%
19	38,871	(C16+C18:1)/C2		0.41		7	1	8		—	0.018%	0.003%	0.021%	—	0.00%
20	12,639	(C16+C18:1)/C2	0.5		0	0	0	0	0	—	—	—	—	—	—
21	10,746	(C16+C18:1)/C2	0.4					0		—	—	—	—	—	—
22	6,593	(C16+C18:1)/C2	0.36				1	1		—	—	0.015%	0.015%	—	0.00%
23	14,419	(C16+C18:1)/C2	0.54		0	0	0	0	0	—	—	—	—	—	—
24	68,307	(C16+C18:1)/C2		0.5	3	5	0	5		0.004%	0.007%	—	0.007%	—	0.00%
25	6,763	(C16+C18:1)/C2	0.37	0.37	0	1	0	1	0	—	0.015%	—	0.015%	—	0.00%
26	47,675	(C16+C18:1)/C2	0.43	0.43		9		9		—	0.019%	—	0.019%	—	0.00%
27	8,672	(C16+C18:1)/C2	0.6					0		—	—	—	—	—	—
28	17,904	(C16+C18:1)/C2	0.45		1	0	0	0	0	0.006%	—	—	—	—	—
29	23,710	(C16+C18:1)/C2	0.32	0.32		1		1		—	0.004%	—	0.004%	—	0.00%
30	9,938	(C16+C18:1)/C2		0.42	0	2	0	2	0	—	0.020%	—	0.020%	—	0.00%
31	25,186	(C16+C18:1)/C2	0.44	0.44	5	3	1	4	0	0.020%	0.012%	0.004%	0.016%	—	0.00%
32	4,724	(C16+C18:1)/C2	0.42	0.42	0	1	0	1	0	—	0.021%	—	0.021%	—	0.00%
33	12,330	(C16+C18:1)/C2	0.438	0.438	6			0		0.049%	—	—	—	—	—
36	12,795	(C16+C18:1)/C2	0.54	—	0	1	0	1		—	0.008%	—	0.008%	—	0.00%
37	8,190	(C16+C18:1)/C2	0.5	0.5	0	0	0	0	0	—	—	—	—	—	—
38	5,509	(C16+C18:1)/C2	0.4		1	0	0	0	0	0.018%	—	—	—	—	—
全体	846,078	(C16+C18:1)/C2	0.44	0.41	39	51	6	57	1	0.005%	0.006%	0.001%	0.007%	1 : 846,078	1.75%
										max	0.055%	0.021%	0.015%	0.021%	25.00%
										min	0.001%	0.002%	0.001%	0.002%	0.00%